


REVISION No. 3

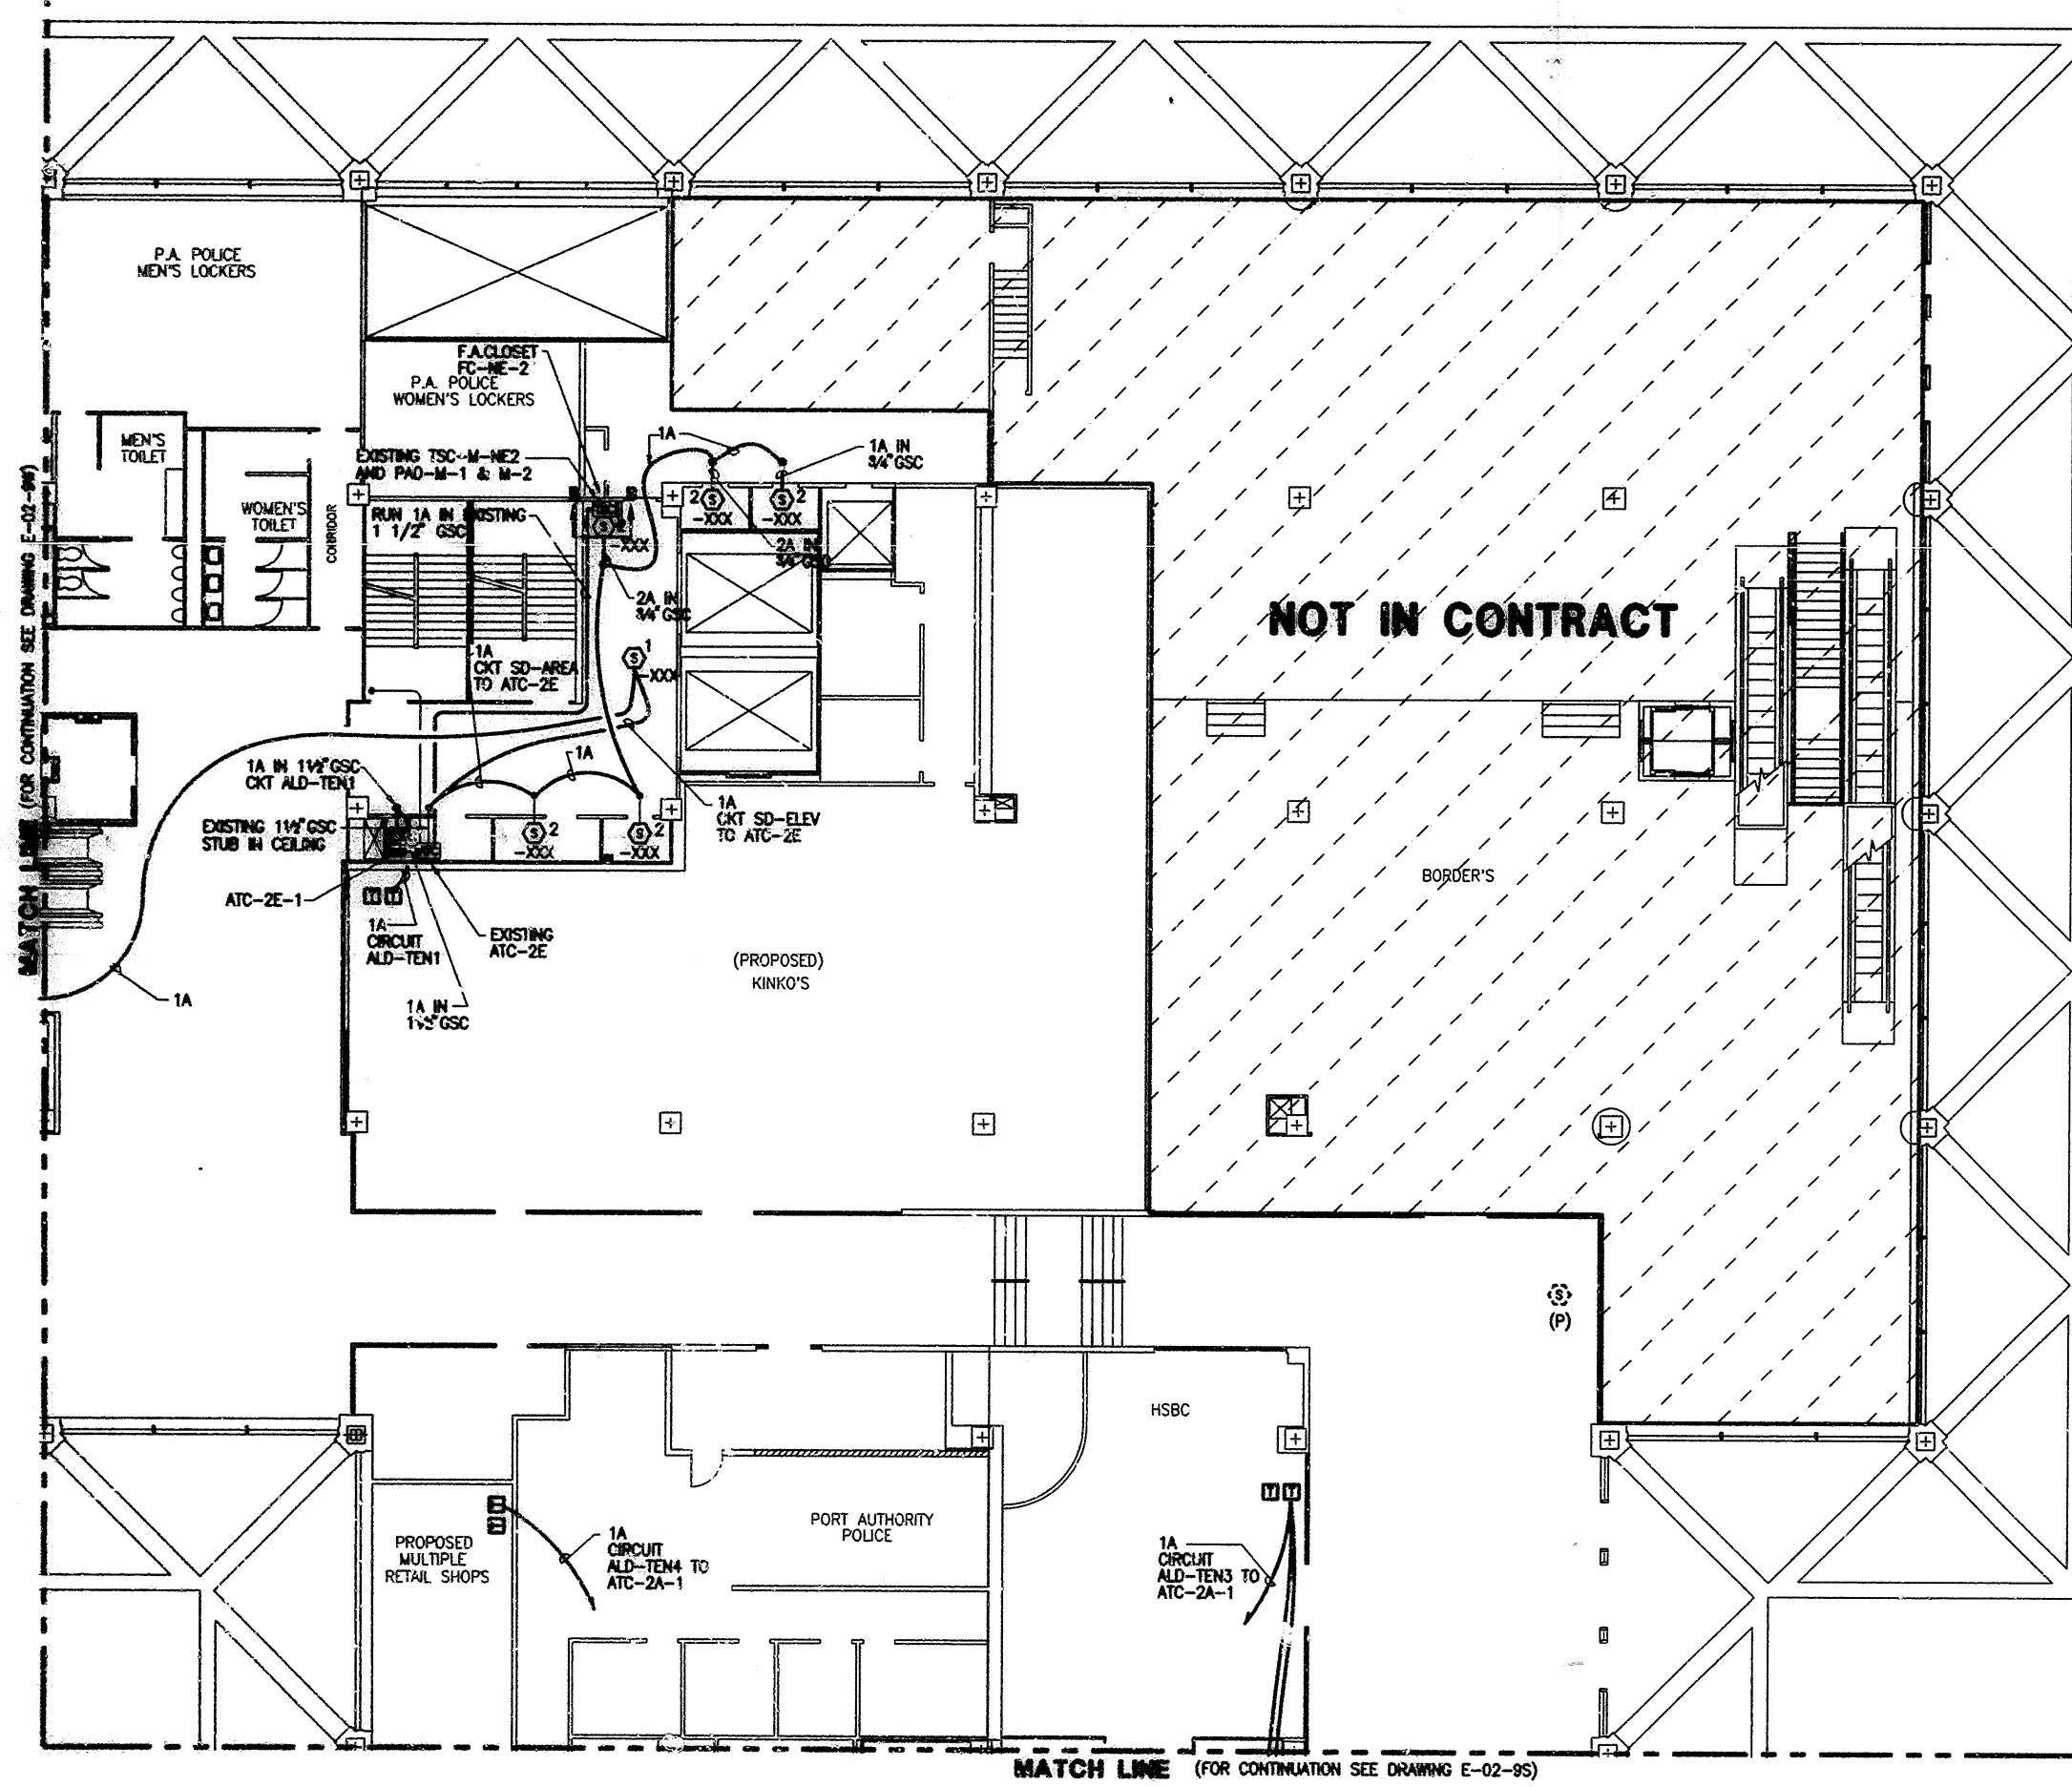

NOTES

1. FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES, SEE DWG. E-02-1. FOR INSTALLATION DETAILS, SEE DWG. E-02-4. FOR WIRING DIAGRAMS, SEE DWG. E-02-5 AND E-02-6.
2. PRIOR TO CEILING DEMOLITION, ALL EXISTING SMOKE DETECTORS AND ASSOCIATED WIRING SHALL BE SECURED UP IN THE CEILING TO ALLOW SPACE FOR THE CONSTRUCTION. DURING THE ENTIRE CONSTRUCTION PHASE, THE EXISTING SMOKE DETECTORS SHALL BE KEPT OPERATIONAL.
3. REMOVAL OF EXISTING SMOKE DETECTORS (THE ONES TEMPORARILY SECURED IN THE CEILING) SHALL BE PERFORMED ONLY AFTER INSTALLED SMOKE DETECTORS ARE TESTED AND OPERATIONAL.
4. SECTION B-B LOCATED AT FIRE ALARM CLOSET FC-M-NE-2. SEE DWG E-02-7 FOR INSTALLATION DETAILS OF PAD M-1 & PAD M-2.

Sheet 14 of 30

DATE: 07/07/99
BY: [Signature]
TITLE: [Signature]
CHIEF ELECTRICAL ENGINEER

No. 1 Date 7/7/99 Revision AS-BID Approved

ENGINEERING DEPARTMENT

WORLD
TRADE
CENTER

ELECTRICAL

Title
FIRE ALARM SYSTEM
DEVICE UPGRADE
PHASE III

5 WTC
PLAZA LEVEL
SMOKE DETECTOR
LAYOUT, INSTALLATION
AND REMOVAL,
EAST PART PLAN

This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

FELDSSTEIN B. FAROUKI A.S.
Designed by Drawn by Checked by

MAY 31, 1999
Date

WTC-861.572 E-02-9E
Contract Number Drawing Number

